CFB boiler's conversion

Technology Modernization & Upgrade Reference Projects

Łukasz Pluta SUMITOMO SHI FW

International Energy and Environment Conference Ostravice, 8-10.09.2025



Agenda

SHI FW Company introduction

CFB Bio-100 conversion project

CFB BIO & RDF conversion project

Q&A





SFW | Powering a decarbonized world for everyone

1800 employees across the globe

20+
locations
around the world

130+
years of experience

800+
successful references worldwide

122 Americas 344 Europe 419 Asia



businesses

Energy Generation

Circular Carbon

Energy Storage

Services



values of SFW



Respect for people



Committed to customers



Passion to innovate and grow



Ownership of results



Safety, integrity and teamwork



SFW Services

Global operator in energy market services

Products and Services

Basic Maintenance (BM)

- Maintenance (outages, hourly rated works, condition monitoring, emergency services)
- Pressure equipment and pressure part replacements
- Steam and condensate pipings
- Auxiliary equipment services and renewals
- Spare parts
- Inspection and specialist services
- EIC Services
- Process, EIC and mechanical designing

Technology, Modernizations and Upgrades (TMU)

- Fuel range expansions and conversions
- Capacity upgrades and process improvements
- Fluidized bed boiler retrofits
- Environmental upgrades
- Plant optimization and feasibility studies

LTSA (Long Term Service Agreement)

- Daily maintenance, outage maintenance
- Boiler condition monitoring
- Nominated plant organization
- Spare Parts & Materials
- Technical advisors on-shore
- Expert services off-shore

Digital Services

- Envelope
- Bed Management and Hotloop Diagnostics
- Grid Condition Monitoring
- Fouling Management
- Leakage detection
- Reporting

Own Manufacturing facilities SFW laboratory services



Our Manufacturing Network

We Deliver Quality Products for New Equipment and After Market Service



China

Established: 1997

Location: Xinhui City, PRC (95 km NW of Hong Kong)
Production Area: 50,000 m²

Capacity: 1,200,000 man-hours

Certifications: ASME code certifications S & PP, China Boiler Manufacturing Certificate Level A, ISO 9001



Poland

Established: 1880

Location: Sosnowiec, Poland Production area: 33,000 m² Capacity: 400,000 man-hours

Certifications: ISO 9001, ISO 14001, OHSAS 18001, PED, ASME S & U stamp, Germany and Poland service cert (HPO, UDT), EN 1090, lab cert EN

ISO/IEC 17025



Thailand

Established: 2000

Location: Chonburi, Thailand Production area: 4,000 m² Capacity: 160,000 man-hours

Certifications: OHSAS 18001, ISO

18001, ASME Code Certification S,R,NB

Stamp



Finland

Established: 1860

Location: Varkaus, Finland
Production area: 4,000 m²
Capacity: 100,000 man-hours


Certifications: ISO 9001, ISO 3834-2, ISO 14001,

OHSAS 18001



CFB Bio-100 Conversion Reference Project

Fortum Czestochowa CFB boiler biomass conversion

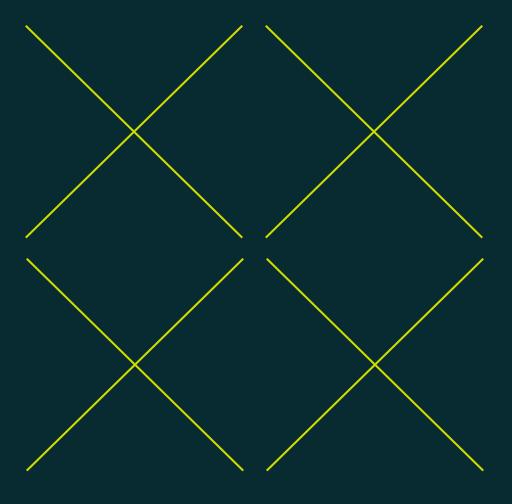



7 -

Original fuel parameters:

Fuel (by heat input):

- Bituminious coal 65 – 100%

LHV 20,4 – 23,1 MJ/kg

Total moisture 5 – 15%
 Ash 20 – 25%

Biomass
 0 – 35% (wood chips, energy willow)

Boiler after modernization:

Fuel (by heat input): 100% certified biomass,

(90% forest-based and 10% agro-based wood chips)

LHV 6,5-15MJ/kg

Total moisture 20-55%

– Ash 1-12%

PSD
 P63 and F10 acc to EN ISO

17225-1, max size ≤350mm

Impurities
 Non-fluidized particles

≤0,1%ds, max size ≤50mm







CFB Bio-100 conversion

CFB Boiler parameters

Original CFB boiler parameters:

Steam capacity: MCR = 77.2 kg/s (278 t/h)

Steam parameters: 111 bar(a), 515°C

Boiler after modernization:

Steam capacity: reduced to ~ 75% MCR,

max ~57.9 kg/s (208 t/h)


min ~30.9 kg/s (111 t/h)

Steam parameters: 111 bar(a), 515°C

Continuous sand feeding to the boiler required



Guarantees

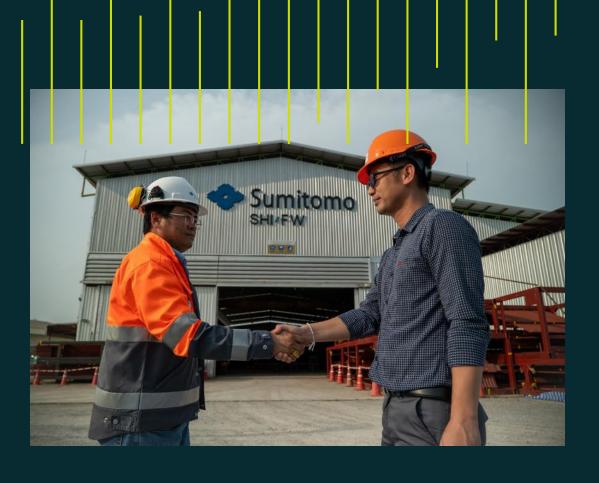

Heat to steam:

Steam pressure

Steam temperature at max load

Steam temperature at min load

SO₂ emission

NOx

Dust

CO

NH3

HCI

HF

Hg

Consumables

Boiler efficiency

Noise emission

Availability

Vibrations

@ max load: 144.5 MW and

@ min load: 77.2 MW

111 bar(a) ±2 bar

 $515^{\circ}C \pm 5^{\circ}C$

≥ 450°C

max 30 mg/m³n

max 120 mg/m³n

max 10/5 mg/m³n

max 50 mg/m³n

max 10 mg/m³n

max 10 mg/m³n

max 1 mg/m³n

max 5 ug/m³n

ammonia water, aux power, sorbent, activated carbon, sand, pressurized

air

>91%

indoor and outdoor




Basic scope of D&E modernization project

- 1. New fuel feeding system + conversion of coal silos into biomass **STAGE 2**
- 2. Step grid STAGE 1
- 3. Bottom ash removal system upgrade STAGE 1
- 4. Flue gas recirculation STAGE 2
- 5. Secondary air system modifications STAGE 2
- A. Delivery of tertiary superheater tube bundles **STAGE2**

Cost effective concept


- 1 No INTREX SH
- 2 No separator type change
- 3 No changes to existing AQCS

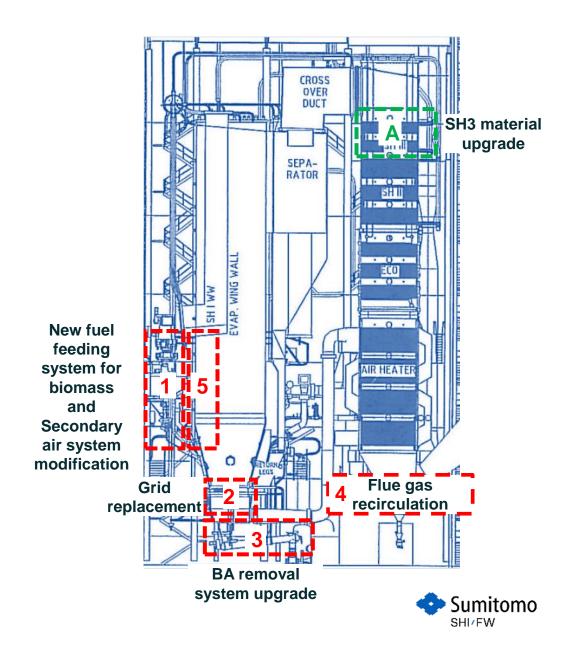


Remaining scope of D&E formula modernization project

-	Boiler Pressure parts	(STAGE 1)
_	Refractory	(STAGE 1)
_	Auxiliary steam systems	(STAGE 2)
_	Thermal and noise insulation	(STAGE 1&2)
_	Fire water and service water systems	(STAGE 1&2)
_	Closed cooling water system	(STAGE 1&2)
_	Pressurized air system	(STAGE 1&2)
_	Central vacuum cleaning	(STAGE 2)
_	Powering and electrification	(STAGE 1&2)
_	Instrumentation up to field boxes	(STAGE 1&2)

- Land development & roads & green in term of architectural, structural and civil scope (STAGE 1)
- Foundation works for new buildings & structures (STAGE 1&2)
- Building adaptation to EuroCode (STAGE 1)
- Input documentation for obtaining permits (STAGE 1)

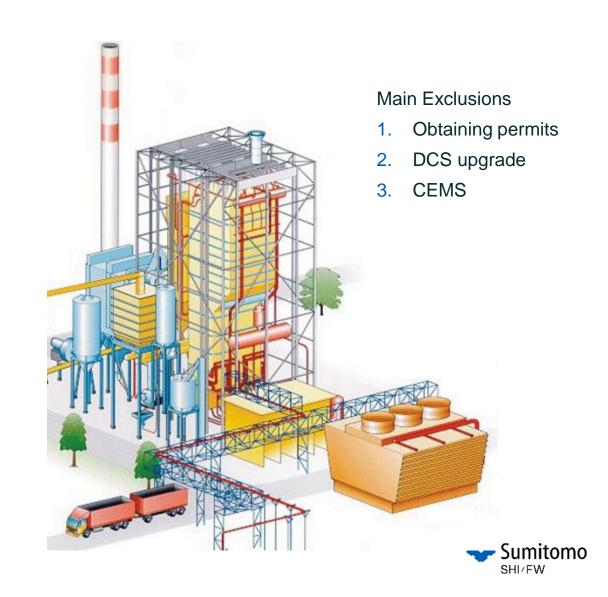


Satellite / Top view with modernization concept for civil & architectural scope

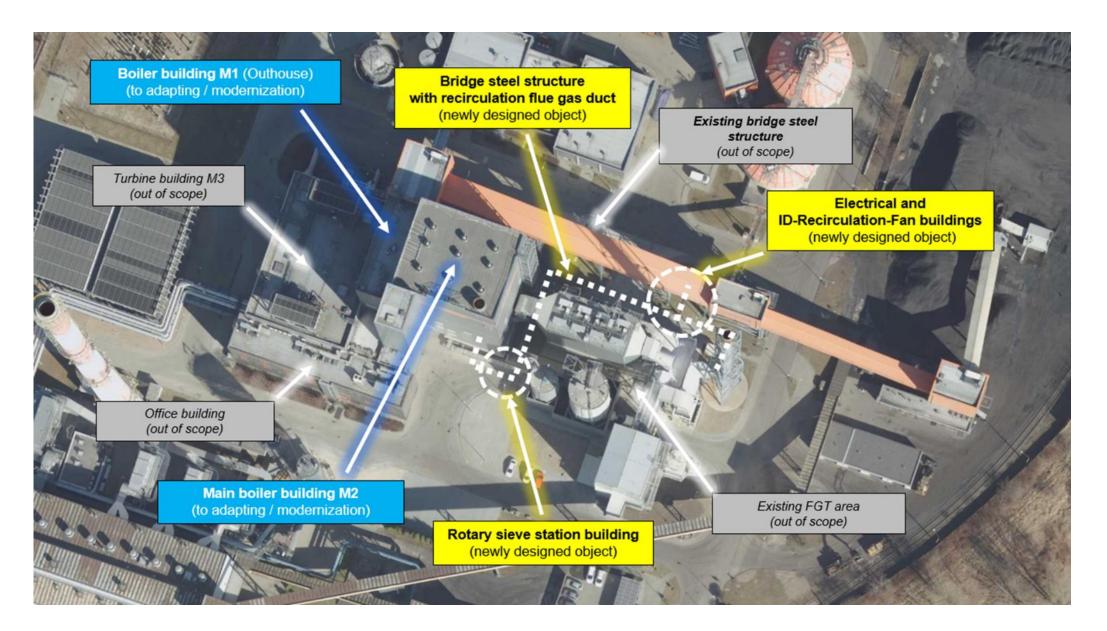



Execution milestone schedule

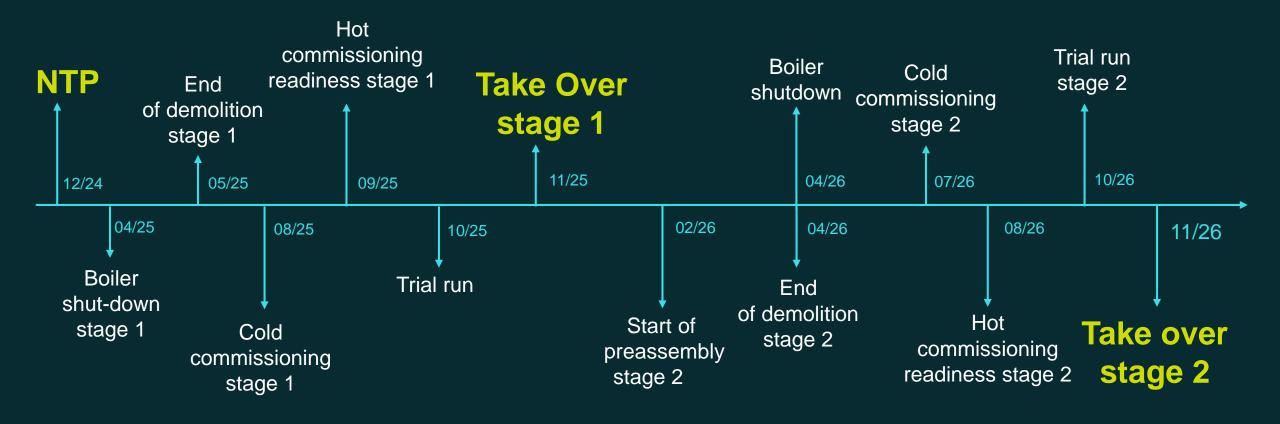

Duration


1st stage 9 months 2nd stage 9 months Total boiler shutdown

9 months

Sumitomo


Reference Project

CFB Bio & RDF conversion

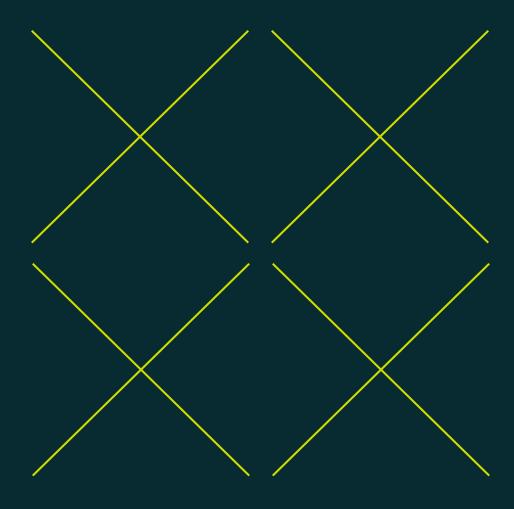



Fuel conversion project development: milestones

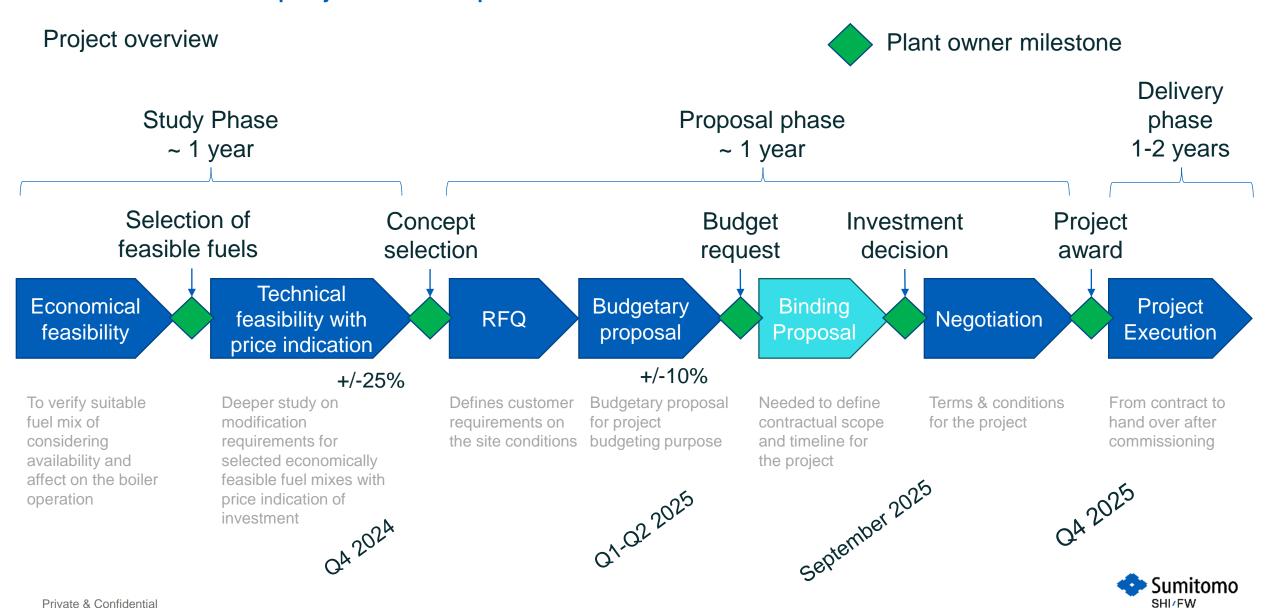

Boiler operating parameters

	Original Design	After Conversion	
Boiler type	Circulating Fluidized Bed		
Heat to Steam	203 MW _{th}	around 175 MW _{th}	
MAX HP-steam flow	270 t/h	min. 233,6 t/h	
MIN HP-steam flow	108 t/h	108 t/h	
HP-steam pressure	92 bar(a)	92 bar(a)	
HP-steam temperature	536°C	525°C	
Boiler load	60% ÷ 100%MCR	50% ÷ 86,5%MCR	
Fuel Mixtures (% - heat input)	100% bituminous coal;60% bituminous coal 40% RDF	100% biomass;70% biomass30% RDF	



Guarantees



Steam flow

Steam pressure

Steam temperature at max load

Steam temperature at min load

SO₂ emission

NOx

Dust

CO

NH3

HCI

HF

Hg

Boiler efficiency

Noise emission

Availability

Residence time

Consumables

min 233,6 t/h

max 108 / 162 t/h

92 bar(a) ±2 bar

 $525^{\circ}C \pm 5^{\circ}C$

≥ 500°C

 $max 67 / 70 mg/m^3n$

max 206 / 180 mg/m³n

 $max 10 / 12 mg/m^3n$

 $max 135 / 160 mg/m^3 n$

 $max 17 / 15 mg/m^3n$

 $max 10 / 9 mg/m^3n$

 $max 1 / 1 mg/m^3n$

 $max 12 / 5 ug/m^3n$

~91%

indoor and outdoor

850C / 2s

sand, ammonia water, auxiliary power



Project Scope

- Boiler island D&E scope
- Technology modernization
- EIC part
 - Power supply for new equipment (motors with FC, cable pulling, swichgears, etc.)
 - Necessary instrumentation (sensors, transmitters, actuated valves) and related accessories (only for delivered by SFW new equipment)
 - BPS/BMS upgrade
 - SFW deliveries only Functional Description + Logic Diagrams + IO list (DCS upgrade excluded)

- Civil

- Adaptation of the existing boiler building to Eurocode EN standard
- Steel structure modifications for new equipment (supports, platforms, reinforcements)
- Cladding and roof opening for crane lifts
- Dismantling and Demolitions works within the scope of works








Technology Scope

Main Technology Systems:

- a) Boiler:
 - Furnace => additional refractory inside furnace
 - Replacement of SH I with new material
- b) Load Burners System:
 - New 2 burners

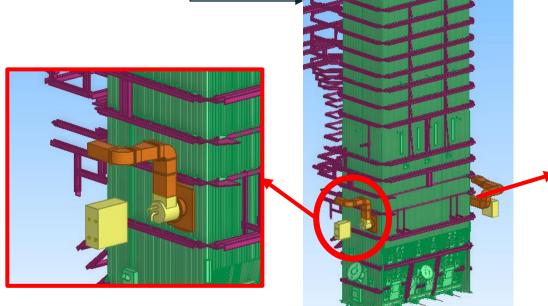

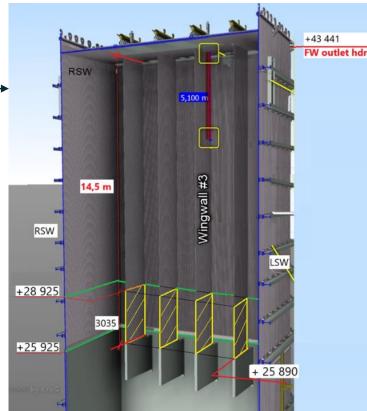






SFW's Scope

Main Technology Systems:


- c) Fuel Feeding System into the silos:
 - New biomass conveyor
 - New RDF conveyor
- d) Biomass Fuel Storage system:
 - New biomass silos
- e) Fuel Feeding System into the boiler

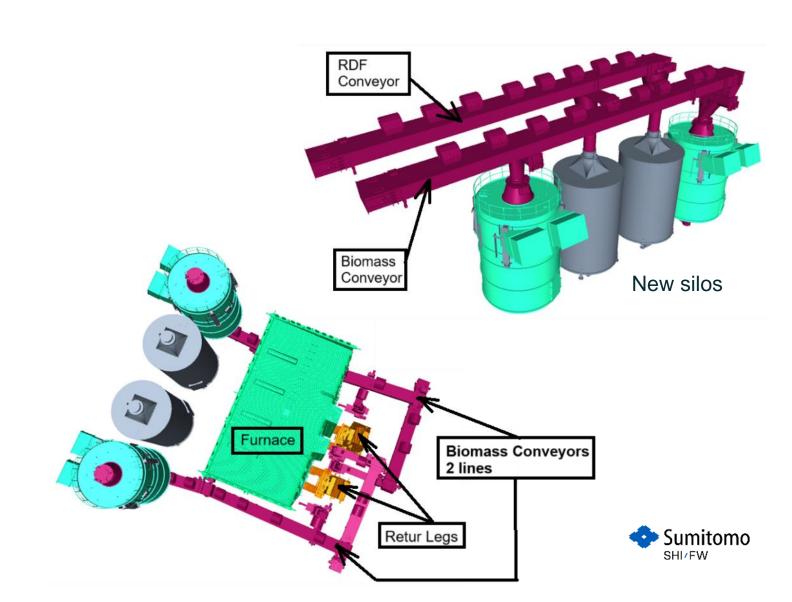

SFW's Scope

Main Technology Systems:

- f) Sand Feeding System:
 - New sand feeding equipment below old limestone silos (two new sand feeding systems)
 - Primary system: 2 points on side walls (existing system + new system)
 - Secondary system: 4 points at return legs (new system)
 (alternatively can be used for kaolin feeding)

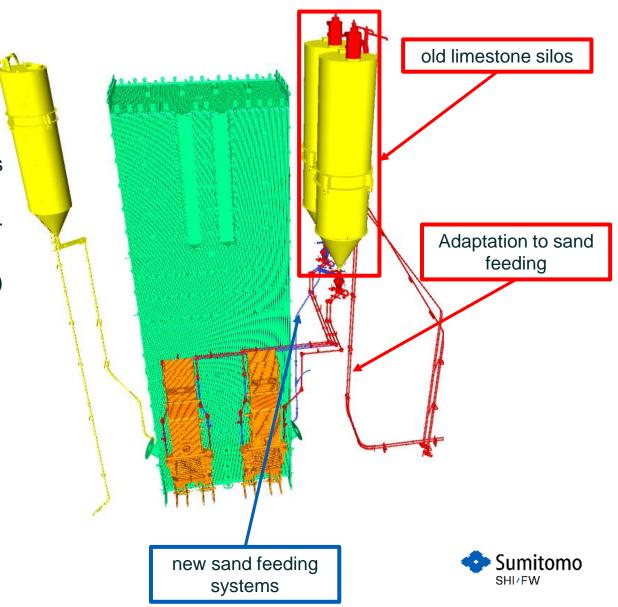

SFW's Scope


Exclusions:

- Obtaining public permits necessary to provide the Works
- Adaptation of the building structure to fire safety requirements;
- Civil works (earth works, foundations, relocations of underground existing facilities, roads, etc.)
- Building equipment (HVAC, VC, lifts, etc.)
- DCS and DCS upgrade;
- External fuel handling system;





Execution milestone schedule

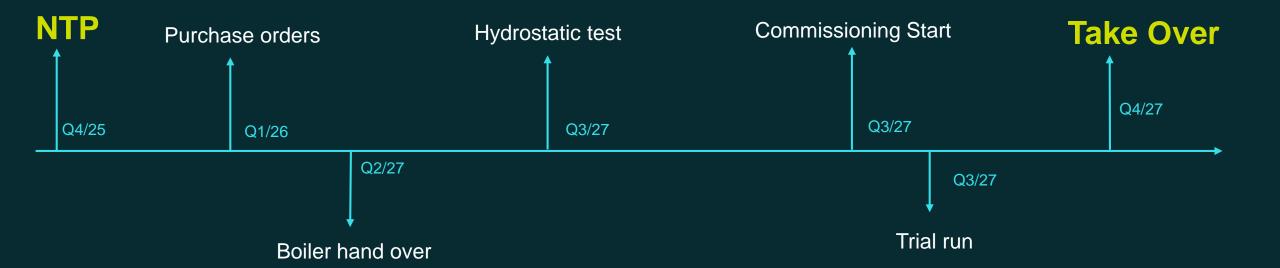

Duration

Execution 25 months

Total boiler shutdown
5 months



A&Q





Thank you

For more information, please contact:

Łukasz Pluta

Director, Services Global Engineering

Lukasz.Pluta@shi-g.com

